- 1-channel isolated barrier
- 24 V DC supply (Power Rail)
- Thermocouple, RTD, voltage or current input
- · 2 relay contact outputs
- Programmable high/low alarm
- · Configurable by PACTware
- · Sensor breakage detection

#### **Function**

This isolated barrier is used for intrinsic safety applications.


The device accepts a variety of inputs including RTDs or thermocouples. The device provides a relay trip whenever it reaches a userprogrammed set point.

The removable terminal block K-CJC-\*\* is available as an accessory for internal cold junction compensation of thermocouples.


A fault is indicated by LEDs acc. to NAMUR NE44 and by user-configured fault indication outputs.


The device is easily configured by the use of the PACTware configuration software.

For additional information, refer to the manual and www.pepperl-fuchs.com.

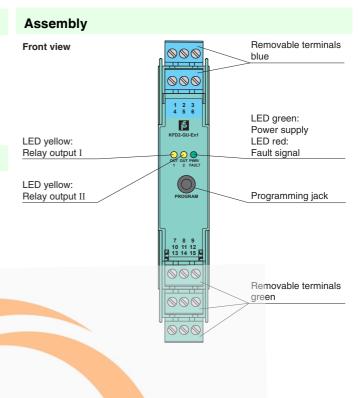

#### Connection

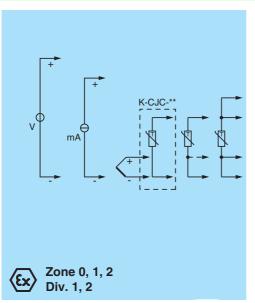



126797_eng.xml	
Date of issue 2017-08-09	
Release date 2017-08-09 14:15	

General specifications	
Signal type	Analog input
Supply	
Connection	Power Rail or terminals 14+, 15-
Rated voltage U <sub>r</sub>	19 35 V DC
Ripple	within the supply tolerance
Power dissipation	0.8 W
Power consumption	0.8 W
Interface	0.0 **
Programming interface	programming socket
Input	
Connection side	field side
Connection	terminals 1, 2, 3, 4, 5, 6
RTD or resistance	type Pt100 (EN 60751: 1995) type Ni100 (DIN 43760) 0 500 Ω (including lead resistance)
Measuring current	approx. 400 μA with RTD
Lead resistance	≤50 Ω per line
	·
Thermocouples	type B, E, J, K, N, R, S, T (IEC 584-1: 1995) type L (DIN 43710: 1985)
Voltage	0 10 V , 2 10 V
Current	0 20 mA , 4 20 mA
Load	$20 \Omega$ for $20$ mA; $200 k\Omega$ for $10 V$
Output	
Connection side	control side
Connection	output I: terminals 7, 8, 9; output II: terminals 10, 11, 12
Output I, II	relay
Contact loading	253 V AC/2 A/500 VA/cos φ min. 0.7; 40 V DC/2 A resistive load
Mechanical life	2 x 10 <sup>7</sup> switching cycles
Transfer characteristics	
Resolution	temperatur <mark>e: 0</mark> .0625 °C, resistance: 62.5 mΩ, voltage: 62.5 μV, current: 625 nA
Deviation	
Voltage input	± 0.02 % of 10 V measuring range
Resistance input	± 0.025 % of measuring range (4-wire connection)
Current input	± 0.02 % of 20 mA measuring range
Pt100	± 0.01 % of abs. temperature value of switching point in K + 0.2 K (4-wire connection)
Thermocouple	± 0.05 % of abs. temperature value of switching point in K + 1.1 K (1.2 K for thermocouple types R and S)
	this includes ± 0.8 K error of the cold junction compensation (+0.9 K for thermocouple types R and S).  Note!  Because the sensitivity of thermocouples is, in general, lower at low temperatures than at high temperatures, the specified accuracy figures cannot be guaranteed when measuring temperatures below those listed here.  -50 °C (type E and K thermocouples)  -100 °C (type J, L and T thermocouples)
	+500 °C (type B thermocouple)
Influence of ambient temperature	
Influence of ambient temperature Pt100	
·	+500 °C (type B thermocouple) $\pm (0.0015 \% \text{ of abs. temperature value of switching point in K + 0.01 K)/K } \Delta T_{amb}^*)$
Pt100 Thermocouple	$\pm$ (0.0015 % of abs. temperature value of switching point in K + 0.01 K)/K $\Delta T_{amb}^*$ ) $\pm$ (0.004 % of abs. temperature value of switching point in K + 0.01 K) / K $\Delta T_{amb}^*$ )
Pt100 Thermocouple Voltage input	$\pm$ (0.0015 % of abs. temperature value of switching point in K + 0.01 K)/K $\Delta T_{amb}^*$ ) $\pm$ (0.004 % of abs. temperature value of switching point in K + 0.01 K) / K $\Delta T_{amb}^*$ ) $\pm$ (0.007 % of the switching point voltage) / K $\Delta T_{amb}^*$ )
Pt100 Thermocouple Voltage input Current input	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K + 0.01 K)/K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of abs. temperature value of switching point in K + 0.01 K)} / K\Delta T_{amb}^*) $ $ \pm (0.007 \% \text{ of the switching point voltage)} / K\Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of the switching point current)} / K\Delta T_{amb}^*) $ $ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 K)} $
Pt100 Thermocouple Voltage input	$\pm$ (0.0015 % of abs. temperature value of switching point in K + 0.01 K)/K $\Delta T_{amb}^*$ ) $\pm$ (0.004 % of abs. temperature value of switching point in K + 0.01 K) / K $\Delta T_{amb}^*$ ) $\pm$ (0.007 % of the switching point voltage) / K $\Delta T_{amb}^*$ ) $\pm$ (0.004 % of the switching point current)/K $\Delta T_{amb}^*$ )
Pt100 Thermocouple Voltage input Current input	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K + 0.01 K)/K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of abs. temperature value of switching point in K + 0.01 K)} / K\Delta T_{amb}^*) $ $ \pm (0.007 \% \text{ of the switching point voltage)} / K\Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of the switching point current)} / K\Delta T_{amb}^*) $ $ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 K)} $
Pt100 Thermocouple Voltage input Current input Influence of supply voltage	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.007 \% \text{ of the switching point voltage})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of the switching point current})/\text{K} \Delta T_{amb}^*) $ $ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 \text{ K}) } $ $ < 0.001 \% \text{ of sensor input range} $
Pt100 Thermocouple Voltage input Current input Influence of supply voltage Input delay	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.007 \% \text{ of the switching point voltage})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of the switching point current})/\text{K} \Delta T_{amb}^*) $ $ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 \text{ K}) } $ $ < 0.001 \% \text{ of sensor input range} $
Pt100 Thermocouple Voltage input Current input Influence of supply voltage Input delay Galvanic isolation	$\pm$ (0.0015 % of abs. temperature value of switching point in K + 0.01 K)/K $\Delta$ T <sub>amb</sub> *) $\pm$ (0.004 % of abs. temperature value of switching point in K + 0.01 K) / K $\Delta$ T <sub>amb</sub> *) $\pm$ (0.007 % of the switching point voltage) / K $\Delta$ T <sub>amb</sub> *) $\pm$ (0.004 % of the switching point current)/K $\Delta$ T <sub>amb</sub> *) $^*$ ) $\Delta$ T <sub>amb</sub> = ambient temperature change referenced to 23 °C (296 K) < 0.001 % of sensor input range ≤ 370 ms (rise time and energizing delay of relay)
Pt100 Thermocouple Voltage input Current input  Influence of supply voltage Input delay Galvanic isolation Output/power supply	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K + 0.01 K)/K } \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of abs. temperature value of switching point in K + 0.01 K)} / K \Delta T_{amb}^*) $ $ \pm (0.007 \% \text{ of the switching point voltage}) / K \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of the switching point current}) / K \Delta T_{amb}^*) $ $ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 K) } $ $ < 0.001 \% \text{ of sensor input range} $ $ \leq 370 \text{ ms (rise time and energizing delay of relay)} $ reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V $_{eff}$
Pt100 Thermocouple Voltage input Current input  Influence of supply voltage Input delay Galvanic isolation Output/power supply Output I/II Power supply/programming input	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K + 0.01 K)/K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of abs. temperature value of switching point in K + 0.01 K)} / K\Delta T_{amb}^*) $ $ \pm (0.007 \% \text{ of the switching point voltage}) / K\Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of the switching point current}) / K\Delta T_{amb}^*) $ $ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 K) } $ $ < 0.001 \% \text{ of sensor input range } $ $ \leq 370 \text{ ms (rise time and energizing delay of relay) } $ reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V $_{eff}$ reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V $_{eff}$
Pt100 Thermocouple Voltage input Current input  Influence of supply voltage Input delay Galvanic isolation Output/power supply Output I/II Power supply/programming input Indicators/settings	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K + 0.01 K)/K} \Delta T_{amb}^*) \\ \pm (0.004 \% \text{ of abs. temperature value of switching point in K + 0.01 K)} / K\Delta T_{amb}^*) \\ \pm (0.007 \% \text{ of the switching point voltage}) / K\Delta T_{amb}^*) \\ \pm (0.004 \% \text{ of the switching point current}) / K\Delta T_{amb}^*) \\ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 K)} \\ < 0.001 \% \text{ of sensor input range} \\ \leq 370 \text{ ms (rise time and energizing delay of relay)} \\ \\ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} \\ \text{no electrical isolation} $
Pt100 Thermocouple Voltage input Current input  Influence of supply voltage Input delay Galvanic isolation Output/power supply Output I/II Power supply/programming input Indicators/settings Display elements	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) \\ \pm (0.004 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) \\ \pm (0.007 \% \text{ of the switching point voltage})/\text{K} \Delta T_{amb}^*) \\ \pm (0.004 \% \text{ of the switching point current})/\text{K} \Delta T_{amb}^*) \\ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 \text{ K})} \\ < 0.001 \% \text{ of sensor input range} \\ \leq 370 \text{ ms (rise time and energizing delay of relay)} \\ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} \\ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} \\ \text{no electrical isolation} \\ \text{LEDs}$
Pt100 Thermocouple Voltage input Current input  Influence of supply voltage Input delay Galvanic isolation Output/power supply Output I/II Power supply/programming input Indicators/settings Display elements Configuration	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.007 \% \text{ of the switching point voltage})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of the switching point current})/\text{K} \Delta T_{amb}^*) $ $ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 \text{ K}) } $ $ < 0.001 \% \text{ of sensor input range} $ $ \leq 370 \text{ ms (rise time and energizing delay of relay)} $ $ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} $ $ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} $ $ \text{no electrical isolation} $ $ \text{LEDs} $ $ \text{via PACTware} $
Pt100 Thermocouple Voltage input Current input  Influence of supply voltage Input delay Galvanic isolation Output/power supply Output I/II Power supply/programming input Indicators/settings Display elements Configuration Labeling	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) \\ \pm (0.004 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) \\ \pm (0.007 \% \text{ of the switching point voltage})/\text{K} \Delta T_{amb}^*) \\ \pm (0.004 \% \text{ of the switching point current})/\text{K} \Delta T_{amb}^*) \\ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 \text{ K})} \\ < 0.001 \% \text{ of sensor input range} \\ \leq 370 \text{ ms (rise time and energizing delay of relay)} \\ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} \\ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} \\ \text{no electrical isolation} \\ \text{LEDs}$
Pt100 Thermocouple Voltage input Current input  Influence of supply voltage Input delay Galvanic isolation Output/power supply Output I/II Power supply/programming input Indicators/settings Display elements Configuration Labeling Directive conformity	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.007 \% \text{ of the switching point voltage})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of the switching point current})/\text{K} \Delta T_{amb}^*) $ $ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 \text{ K}) } $ $ < 0.001 \% \text{ of sensor input range} $ $ \leq 370 \text{ ms (rise time and energizing delay of relay)} $ $ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} $ $ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} $ $ \text{no electrical isolation} $ $ \text{LEDs} $ $ \text{via PACTware} $
Pt100 Thermocouple Voltage input Current input  Influence of supply voltage Input delay Galvanic isolation Output/power supply Output I/II Power supply/programming input Indicators/settings Display elements Configuration Labeling	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.007 \% \text{ of the switching point voltage})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of the switching point current})/\text{K} \Delta T_{amb}^*) $ $ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 \text{ K}) } $ $ < 0.001 \% \text{ of sensor input range} $ $ \leq 370 \text{ ms (rise time and energizing delay of relay)} $ $ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} $ $ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} $ $ \text{no electrical isolation} $ $ \text{LEDs} $ $ \text{via PACTware} $
Pt100 Thermocouple Voltage input Current input  Influence of supply voltage Input delay Galvanic isolation Output/power supply Output I/II Power supply/programming input Indicators/settings Display elements Configuration Labeling Directive conformity	$ \pm (0.0015 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of abs. temperature value of switching point in K} + 0.01 \text{ K})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.007 \% \text{ of the switching point voltage})/\text{K} \Delta T_{amb}^*) $ $ \pm (0.004 \% \text{ of the switching point current})/\text{K} \Delta T_{amb}^*) $ $ ^*) \Delta T_{amb} = \text{ambient temperature change referenced to 23 °C (296 \text{ K}) } $ $ < 0.001 \% \text{ of sensor input range} $ $ \leq 370 \text{ ms (rise time and energizing delay of relay)} $ $ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} $ $ \text{reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V}_{eff} $ $ \text{no electrical isolation} $ $ \text{LEDs} $ $ \text{via PACTware} $
Pt100 Thermocouple Voltage input Current input  Influence of supply voltage Input delay Galvanic isolation Output/power supply Output I/II Power supply/programming input Indicators/settings Display elements Configuration Labeling Directive conformity Electromagnetic compatibility	± (0.0015 % of abs. temperature value of switching point in K + 0.01 K)/K ΔT <sub>amb</sub> *)  ± (0.004 % of abs. temperature value of switching point in K + 0.01 K) / KΔT <sub>amb</sub> *)  ± (0.007 % of the switching point voltage) / KΔT <sub>amb</sub> *)  ± (0.004 % of the switching point current)/KΔT <sub>amb</sub> *)  * (0.004 % of the switching point current)/KΔT <sub>amb</sub> *)  *) ΔT <sub>amb</sub> = ambient temperature change referenced to 23 °C (296 K)  < 0.001 % of sensor input range  ≤ 370 ms (rise time and energizing delay of relay)  reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V <sub>eff</sub> reinforced insulation according to IEC/EN 61010-1, rated insulation voltage 300 V <sub>eff</sub> no electrical isolation  LEDs via PACTware space for labeling at the front



end xm
126797
2017-08-09
Date of issue
44.45

Conformity			
Electromagnetic compatibili	ty	NE 21:2006	
Degree of protection		IEC 60529:2001	
Ambient conditions			
Ambient temperature		-20 60 °C (-4 140 °F)	
Mechanical specifications	<b>;</b>		
Degree of protection		IP20	
Connection		screw terminals	
Mass		approx. 150 g	
Dimensions		20 x 119 x 115 mm (0.8 x 4.7 x 4.5 inch) , housing type B2	
Mounting		on 35 mm DIN mounting rail acc. to EN 60715:2001	
Data for application in corwith hazardous areas	nnection		
EU-Type Examination Certif	icate	BAS 98 ATEX 7152	
Marking		$\textcircled{k}$ II (1)GD, I (M1) [Ex ia Ga] IIC, [Ex ia Da] IIIC, [Ex ia Ma] I (-20 °C $\leq$ T <sub>amb</sub> $\leq$ 60 °C), [circuit(s) in zone 0/1/2]	
Input		Ex ia Ga, Ex ia Da, Ex ia Ma	
Voltage	$U_o$	10.5 V	
Current	I <sub>o</sub>	27 mA	
Power	$P_{o}$	70 mW	
Supply			
Maximum safe voltage	U <sub>m</sub>	40 V DC (Attention! The rated voltage can be lower.)	
Certificate		TÜV 99 ATEX 1493 X	
Marking			
Galvanic isolation			
Input/Other circuits		safe electrical isolation acc. to IEC/EN 60079-11, voltage peak value 375 V	
Directive conformity			
Directive 2014/34/EU		EN 60079-0:2012+A11:2013, EN 60079-11:2012, EN 60079-15:2010	
International approvals			
UL approval			
Control drawing		116-0173 (cULus)	
IECEx approval		IECEx BAS 06.0022	
Approved for		[Ex ia Ga] I <mark>IC,</mark> [Ex ia Da] IIIC, [Ex ia Ma] I	
General information			
Supplementary information		Observe the certificates, declarations of conformity, instruction manuals, and manuals where applicable. For information see www.pepperl-fuchs.com.	

## **Accessories**

# Power feed module KFD2-EB2

The power feed module is used to supply the devices with 24 V DC via the Power Rail. The fuse-protected power feed module can supply up to 150 individual devices depending on the power consumption of the devices. A galvanically isolated mechanical contact uses the Power Rail to transmit collective error messages.

## **Power Rail UPR-03**

The Power Rail UPR-03 is a complete unit consisting of the electrical inset and an aluminium profile rail 35 mm x 15 mm. To make electrical contact, the devices are simply engaged.

### **Profile Rail K-DUCT with Power Rail**

The profile rail K-DUCT is an aluminum profile rail with Power Rail insert and two integral cable ducts for system and field cables. Due to this assembly no additional cable guides are necessary.



Power Rail and Profile Rail must not be fed via the device terminals of the individual devices!

# K-CJC-\*\*

This removable terminal block with integrated temperature measurement sensor is needed for internal cold junction compensation for thermocouples. One K-CJC-\*\* is needed for each channel.

### **PACT***ware*<sup>™</sup>

Device-specific drivers (DTM)

### Adapter K-ADP-USB

Programming adapter for parameterisation via the serial USB interface of a PC/Notebook

Contact: +971507924960

date 2017-08-09

Email:

sales@industrytechstore.com Websit

